
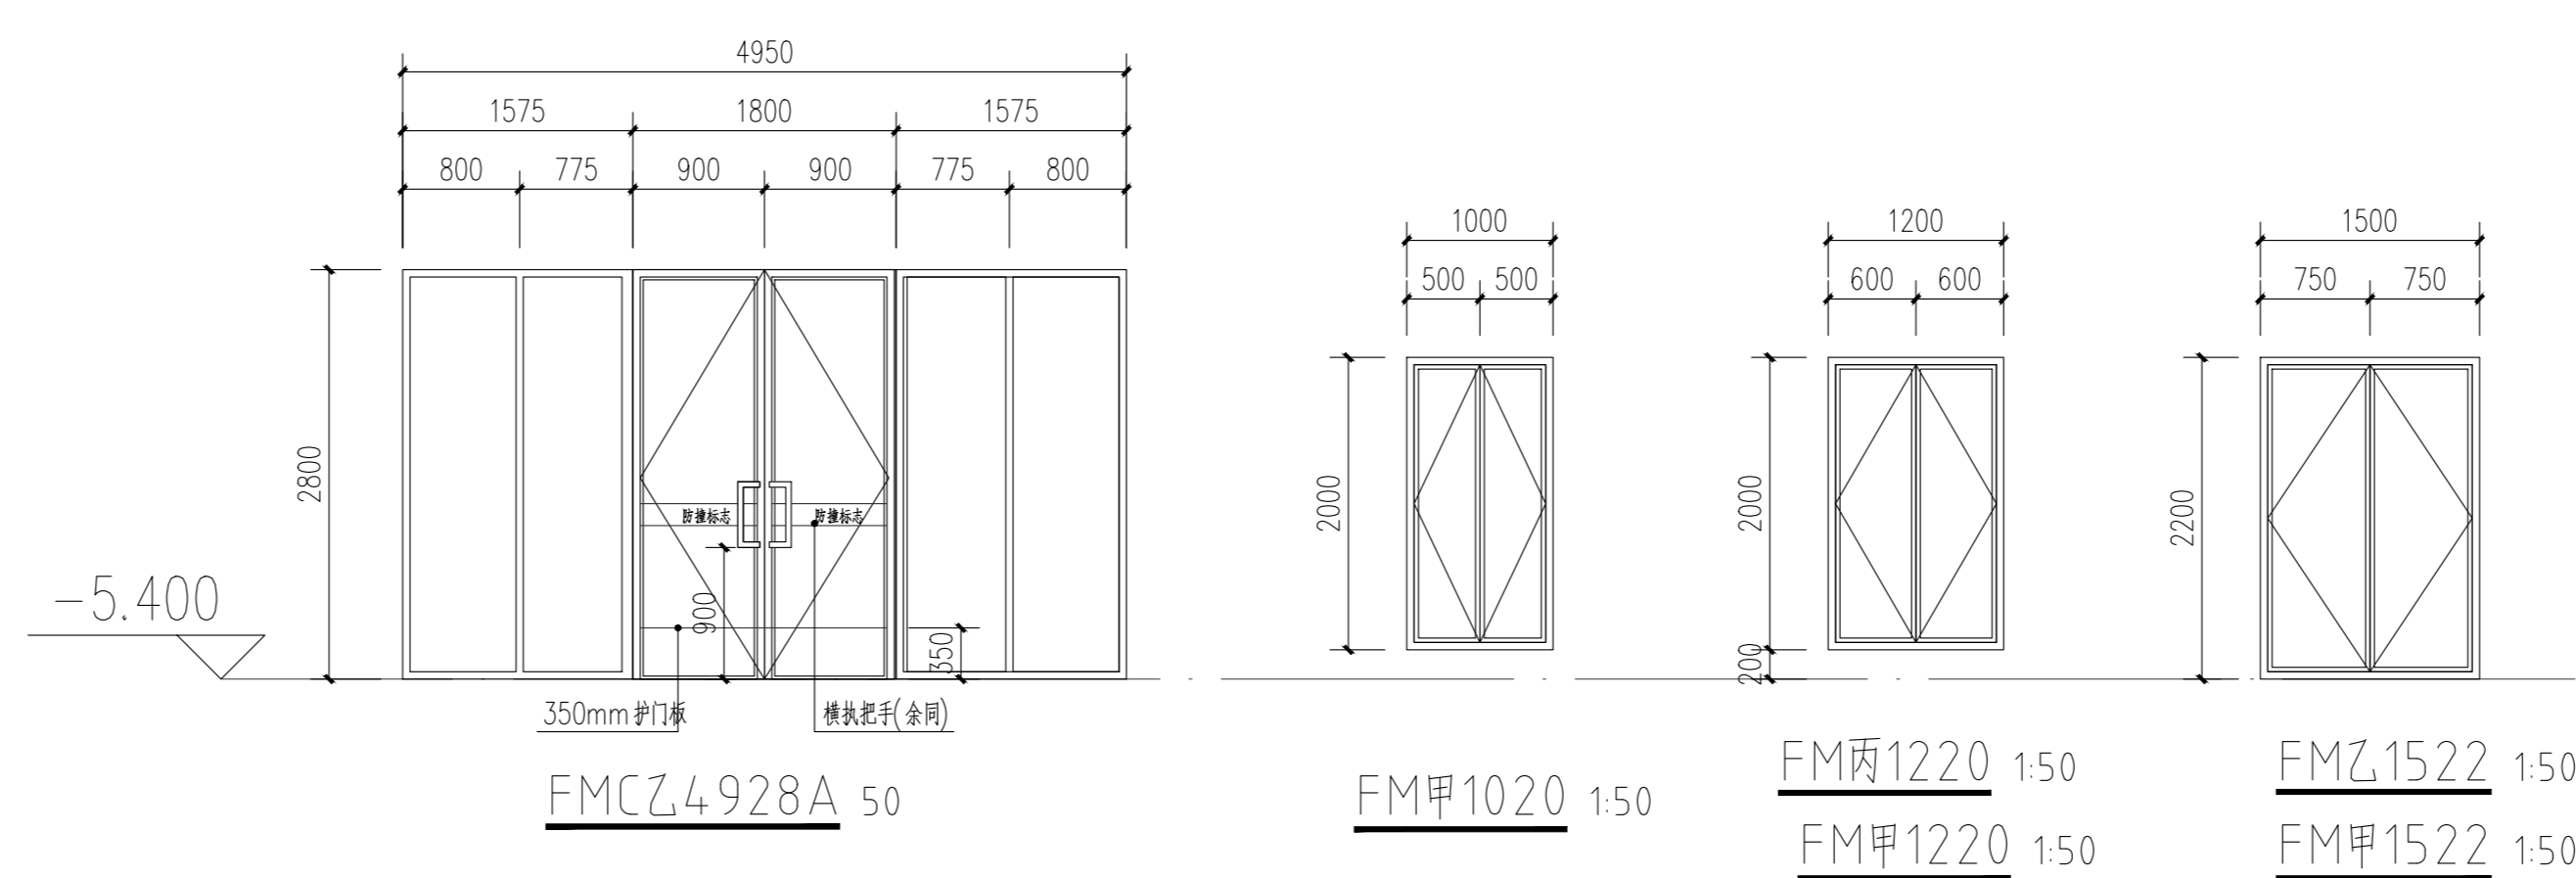


类型	设计编号	洞口尺寸(mm)	数量	选用型号	备注
甲级防火门	FM 甲1020	1000X2000	2	木质甲级防火门耐火极限≥1.5h	设备用房门设置200mm高C25细石混凝土门槛
	FM 甲1020'	1000X2000	1		
	FM 甲1022	1000X2200	11		
	FM 甲1122	1100X2200	3		
	FM 甲1220	1200X2000	20		
	FM 甲1222	1200X2200	5		
	FM 甲1522	1500X2200	46		
	FM 甲1822	1800X2200	1		
特级防火卷帘	FJM 特5025	5000X2500	3	耐火极限≥3.0h	双轨无机纤维复合特级防火卷帘门
	FJM 特5525	5500X2500	10		
	FJM 特7030	7000X3000	1		
乙级防火门	FM 乙1522	1500X2200	26	木质乙级防火门耐火极限≥1.0h	
	FM 乙1822	1800X2200	1		
丙级防火门	FM 丙1220	1200X2000	1	木质丙级防火门耐火极限≥1.0h	设置200mm高门槛
乙级防火门窗	FMC 乙4828A	4850X2800	1	耐火极限≥1.0h	电梯厅乙级防火门联窗
普通窗	BYC7820	7800X2000	1		柴发进风井百叶窗
洞口	DK2524	2500X2200	1		柴发排风井墙体开洞

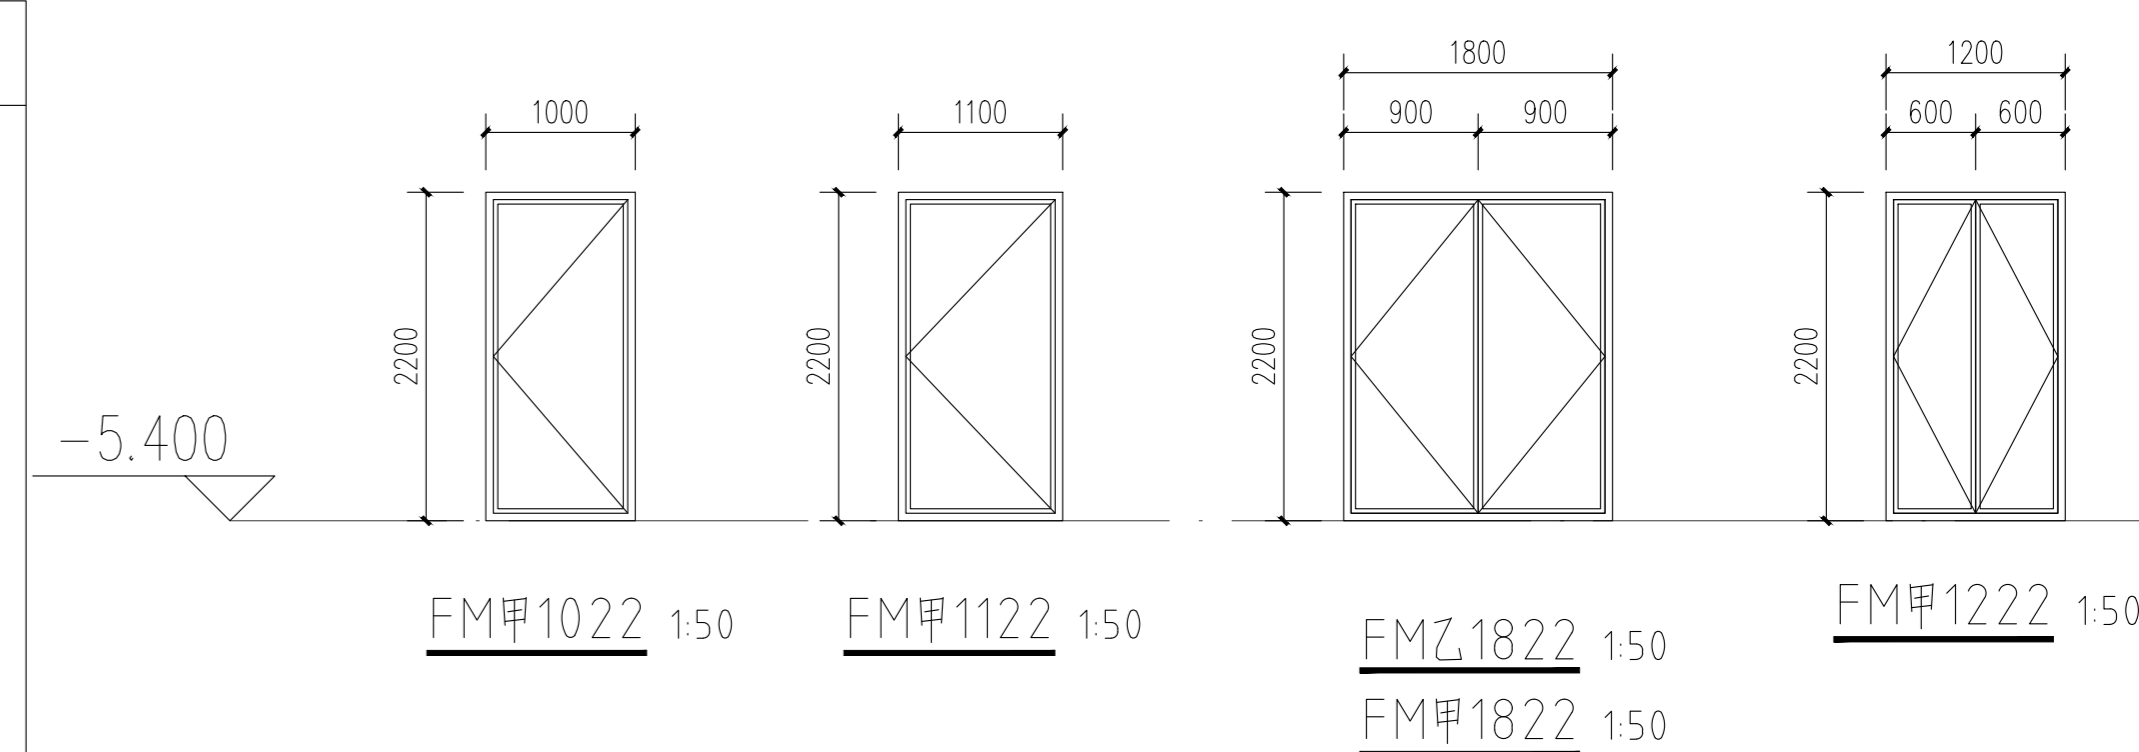

注：1、防火卷帘洞口两侧应为结构柱或构造柱，当为结构柱时尺寸详见结施，  
当为构造柱时尺寸为 $200 \times 400$ 或由卷帘生产厂家确定。  
2、本图仅为为了表达防火卷帘对车库停车位、通车道宽度的影响，防火卷帘导轨的固定及封闭由  
卷帘生产厂家配套解决。